



Universitat de Girona

Departament d'Enginyeria
Industrial

This report is developed after carrying out the corresponding trials established in the scientific collaboration agreement of mechanic-fluid behavior of rectangular airflow ducts.

TECHNICAL REPORT

REQUESTER

Mr. Francesc Bolló. Technical Director
POLIURETANOS S.A.
C/ Matamala s/n
17244 Cassà de la Selva (Girona)

TRIAL OBJECTIVE

Determining the rigidity of a sheet sample for the manufacturing of airflow ducts commercially named "PIR-ALU 45 panel".

SAMPLE CHARACTERISTICS

PIR-ALU 45 panel made up with 45 grs/dm³ density polysocianurate nucleus layered with embossed aluminum plates of 220 grs/m² of density and 80 μ m of thickness. The panel thickness is of 20mm.

TRIAL METHOD

The trial is to test the mechanical rigidity on two different types of airflow conduct sheets according to the Norma project "Ductwork standard. Ductwork made of insulation ductboards" CEN/TC156/WG3N207 section 6.1 (*see annex*).

RESULTS

PIR-ALU 45: In this case a calibrated weight is applied for the 608.73 grs value trial which implies a strength of 5.965 N in order to deform the sheet.

Two different cut directions were tested for the same type of sheet:

- A: In a longitudinal sense to manufacturing.
- L: In a perpendicular sense to manufacturing.

The results are obtained from types of material and kind of cuts when setting up the sample.



Universitat de Girona

Departament d'Enginyeria
Industrial

PIR-ALU 35 Panel (A)		
Sample	Deformation (mm)	EI (Nmm ²)
1	15.15	150482
2	15.15	150482
3	14.6	156151
4	13.3	171414
5	13.55	168251
6	13.3	171414
Mean EI		161366
EI Standard Deviation		10134

PIR-ALU 35 Panel (L)		
Sample	Deformation (mm)	EI (Nmm ²)
1	12.15	187638
2	11.95	190779
3	11.2	203554
4	11	207255
5	11	207255
6	11.4	199983
Mean EI		199411
EI Standard Deviation		8410

In order to calculate the result of the Young Module per inertia (EI) referred to 1 mm of width is done by using the formula provided in the Norma specifications used in the flexion trial of one plate with a single support.

The recommended deformation interval was kept in order not to have permanent deformations.

On the other hand, all original sample were weighted to establish if there was a important variation of density for each type product. The mean density results are detailed in the following table:

PIR-ALU 35 (A)		PIR-ALU 35 (L)	
Mean Density	35,6 grs/dm³	Mean Density	36,1 grs/dm³

Weight variation is almost unnoticeable (less than 3%)

Samples show a very similar density to the described commercial values.

O.K.
Area Manager

Joaquim Yelazos Solé.
Fluid Mechanics Lecturer

This document has two sealed pages.

Universitat de Girona
Departament d'Enginyeria
Industrial

Trial date: Girona, July 24, 1998.

Fluids Laboratory Manager

Josep R. González Castro.
Fluid Mechanics Associated Teacher

ANEXO

(1 página)


Proyecto de Norma Europea "Ductwork standard. Ductwork made of insulation ductboards"
CEN/TC 156/WG3 N207. 4ª revisión. Apartado 6.1.

One end of the sample is placed on a horizontal surface as shows the figure below, leaving the other end free in a length of 750 mm. In a point at 700 mm of the end of the support surface, a weight (W) is applied slowly and retired several times, until the distances to a reference plane, with and without the weigh, d_1 and d_2 , are constant. Then d is calculated as the difference between d_1 and d_2 .

The weigh W is chosen to have a deformation , d , in the range of 10 to 20 mm. As a guide, on function of the expected EI_U , can be taken:

Expected EI_U	$W(Nw)$
55.000	1.3
90.000	2.6
160.000	3.9

Sample size: 1200 x 200 x thickness.

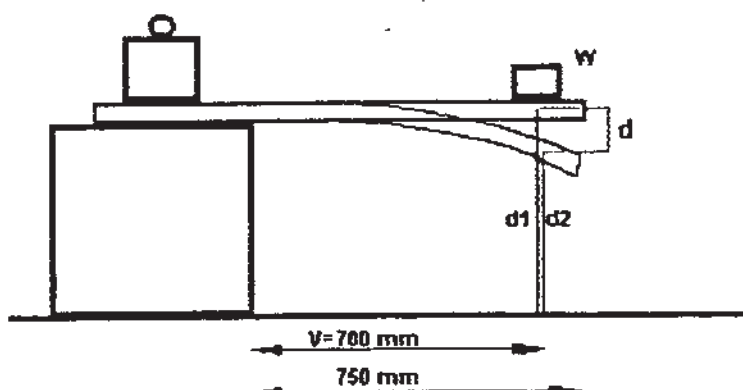

EI_U is calculated using the following expression:

$$EI_U = \frac{W / AV^3}{3d}$$

EI_U (Nmm ²)	: Flexural rigidity for 1mm wide
W (Newton)	: Weight applied
A (mm)	: Sample widthness = 200 mm
d (mm)	: Deformation under load
V (mm)	: Distance between the support surface and the point where the load is applied=700 mm